


## NOTES:

- ① FINISH GRADE.
- ② SET TOP OF BOX ABOVE FINISH GRADE:  
1" IN SOD, 2" IN PLANTER OR  
DECOMPOSED GRANITE.
- ③ ALLOW 3" BETWEEN TOP OF VALVE  
BOX AND PVC PIPE.
- ④ CARSON 910 OR EQUAL 10" DIAMETER  
GREEN PLASTIC VALVE BOX WITH  
LOCKING LID.
- ⑤ 6" DIAMETER SCHEDULE 40 PVC PIPE.  
LENGTH AS REQUIRED.
- ⑥ PEA GRAVEL — 1 CU. FT.
- ⑦ (3) COMMON BRICKS FOR SUPPORT.
- ⑧ LINE SIZE BALL VALVE, SEE PROJECT  
SPECS. FOR MANUFACTURER.
- ⑨ 6" MINIMUM DEPTH PEA GRAVEL.
- ⑩ SCHEDULE 40 OR CLASS 315 PVC  
PRESSURE LINE, 24" MINIMUM COVER.
- ⑪ 1/4" GALVANIZED WIRE CLOTH.

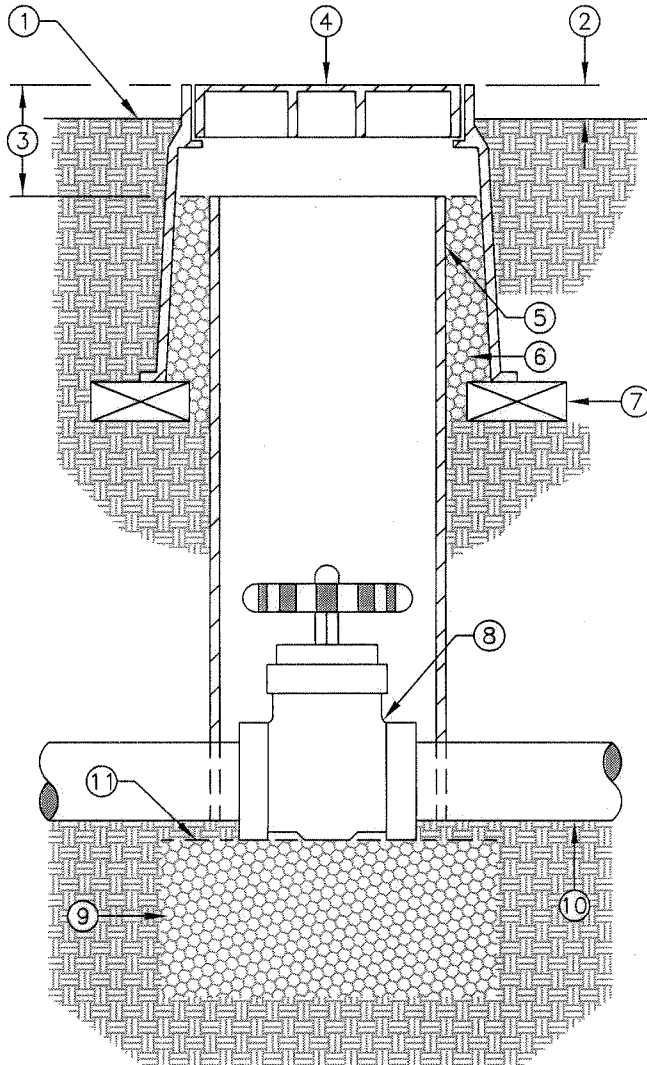

SECTION VIEW

REVISION	BY	DATE	APP. BY COUNCIL

CITY OF CHICO

STANDARD PLAN

DRAWN BY: GL DATE: 10/06  
 CHECKED BY: DB SCALE: NONE  
 APPROVED: [Signature]  
 DIRECTOR OF ENGINEERING

TRU-UNION BALL VALVE

NO.  
LS-II

SHEET 1 OF 1