


**EXISTING CURB-PROPOSED GUTTER**

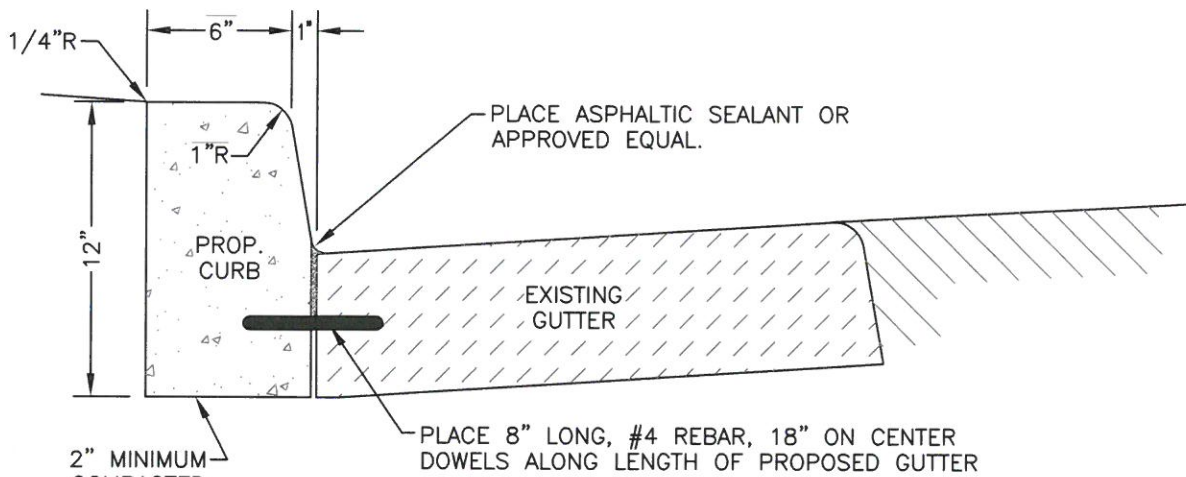

**PROPOSED CURB-EXISTING GUTTER**

**NOTES:**

1. WHEN INSTALLING BOTH CURB & GUTTER, POUR MONOLITHIC SECTION.
2. WHEN REPLACING ROLLED CURB & GUTTER, USE STANDARD NO. S-2 IN COMBINATION WITH METHOD OF MATCHING EXISTING A.C. DETAIL (TOP).
3. INSTALL 1/4" WIDE EXPANSION JOINTS, MATCH EXISTING - MAX. INTERVAL 48 FT. AND 1/8" SCORED CONTROL JOINTS, MATCH EXISTING - MAX. INTERVAL 12 FT.
4. ALL CONCRETE IN CITY RIGHT OF WAY SHALL BE CLASS 2 CONCRETE: 590 LBS OF CEMENTITIOUS MATERIAL PER CUBIC YARD, WITH A MINIMUM OF 1 LB OF LAMP BLACK PER CUBIC YARD.
5. CURING COMPOUND SHALL BE USED AT A MINIMUM: PIGMENTED ASTM C-309 TYPE 2 CLASS B OR NON-PIGMENTED ASTM C-309 TYPE 1 CLASS B.

REVISION	BY	DATE	APP. BY	COUNCIL

**CITY OF CHICO**

**STANDARD PLAN**

DRAWN BY: GL DATE: 02/2016  
 CHECKED BY: BO SCALE: NONE  
 APPROVED: Paul Otto  
 PUBLIC WORKS DIRECTOR-ENGINEERING

**EXISTING CURB AND/OR  
 GUTTER REPLACEMENT  
 DETAILS**

NO.  
**S-3**

SHEET 1 OF 1