
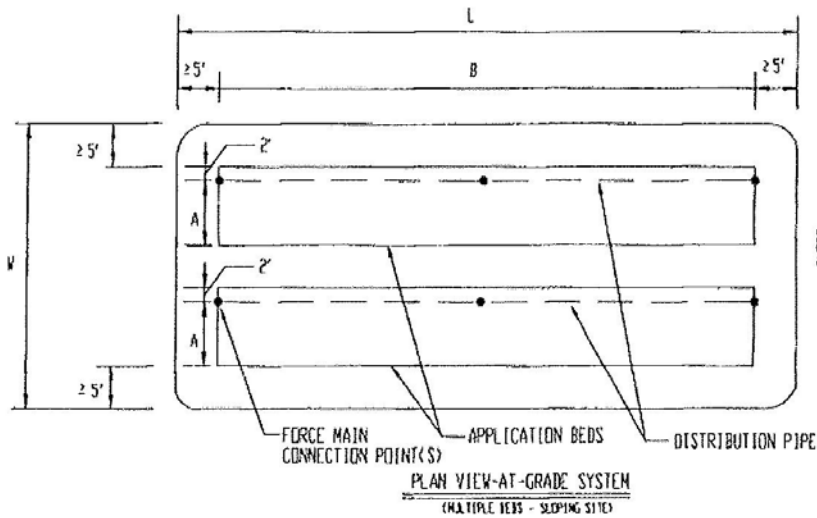


Illustration E.11: Type 4 - At-Grade System: Multiple Bed, Sloping Site

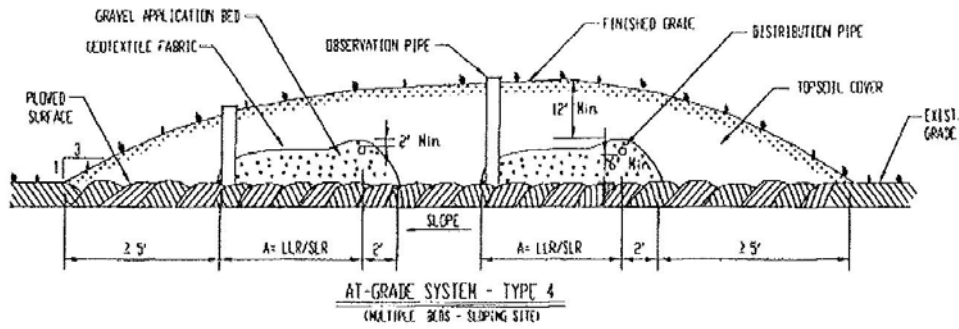

- Force main must connect to the distribution pipe from the upslope or the endslope. The force main cannot be located in the downslope area on landslopes of 2% or greater.
- Observation pipes may be installed in the application bed.