


Corporation Stop, Brass, AWWA Thread, Copper, With Copper X Female I.P. Thread Quarter Bend. MUELLER H-15020

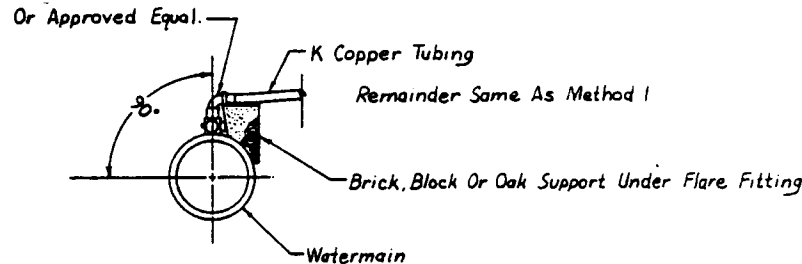

METHOD 1

METHOD 2

(Ord. 77-168. Passed 11-21-77.)

NOTES

1. Minimum Allowable Distance Between Tap And Pipe Joint Shall Be 18".

2. Minimum Allowable Distance Between Taps Shall Be 18".

MINIMUM SIZES OF SERVICE & METERS

Building Size	Length of Service Pipe Main to Meter		Meter Size
	100' or less	50' or less	
Single Family	1"	3/4"	5/8"
Two Family	1 1/2"	1"	5/8" ea. unit
Four Apartments	2"	1 1/2"	1"
12 Unit Building	2"	2"	1" or 1 1/2"

*Larger meter to be used where second floor will be 15'-0" or more above ground line.

CITY OF ELYRIA, OHIO
ENGINEERING DEPARTMENT

TYPICAL WATER TAP

M.R.N.	5/12/96	DR. BY	J.S.	DATE	7-77	DRAWING
N.J.T.	11/1/95	CK. BY	L.S.D.	DATE	2-27-77	
BY	DATE	APPROVED		CITY ENGINEER		2-904